



COOK Gemini Isolator Kit

Ceiling, Wall and Cabinet Fans

SUPPLEMENTAL INSTALLATION INSTRUCTIONS

This publication contains the installation instructions for the GIK - Gemini Isolator Kit. Carefully read this publication prior to installation.

Loren Cook catalog, *Gemini*, provides additional information describing the equipment, fan performance, available accessories and specification data.

For additional safety information, refer to AMCA publication 410-96, *Safety Practices for Users and Installers of Industrial and Commercial Fans*.

All of the publications listed above can be obtained from Loren Cook Company by phoning 417/869-6474, extension 166; by FAX at 417/832-9431; or by e-mail at info@loren-cook.com.

For information and instructions on special equipment, contact Loren Cook Company at 417/869-6474.

Receiving and Inspection

Upon receiving the parts for the Gemini Isolator Kit, carefully inspect the parts package for any damage and/or shortage.

WARNING

This unit has rotating parts. Safety precautions should be exercised at all times during installation, operation, and maintenance. ALWAYS disconnect power prior to working on fan.


Installation

- Remove mounting brackets from box. (Supplied with fan.)
- Install isolator bushings into 1/2" holes in mounting brackets with thick side of bushing facing the floor. Isolator bushings may be heated to ease installation.
- Install mounting brackets onto fan using screws provided.
- Slip eyelets into isolator bushings with flange side down.
- Hang fan on four 1/4" x 20 tpi "all thread" per illustration using eight flanged 1/4" x 20 tpi nuts. Adjust fan height and level per installation requirements.
- Tighten nuts against eyelets to capture isolator bushings securely.

Parts List - GIK

Part Name	Qty.
Isolator Bushings	4
Flanged 1/4" x 20 Nuts	8
Eyelets	4

Pre Assembly

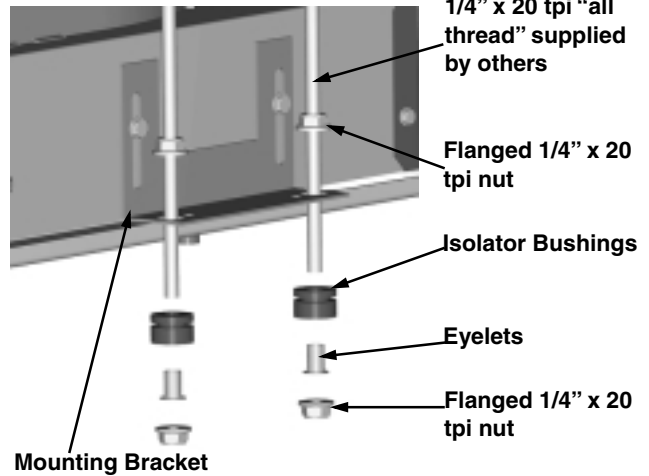

Assembled

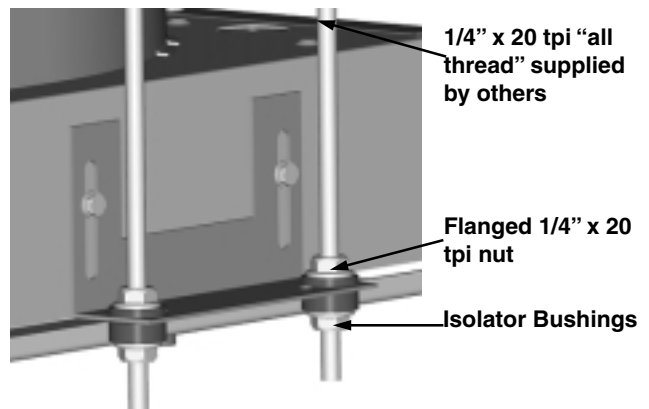


Illustration of Assembled Unit

